

Sanitary Components

Technical document 076-06

Connection elements for toilets,
urinals and squat toilets

The CSTB (Centre Scientifique et Technique du Bâtiment), a public establishment supporting innovation in construction, has four key activities: research, expertise and the assessment and dissemination of knowledge, organised to meet the challenges of ecological and energy transition in the construction sector. Its field of competence covers construction materials, buildings and their integration into districts and towns.

With over 900 employees, its subsidiaries and networks of national, European and international partners, the CSTB group works for all the stakeholders in the construction sector to push forward the quality and safety of buildings.

All reproduction or representation, complete or partial, by whatever means, of the pages published in this technical document and executed without the authorisation of the CSTB is illegal and constitutes a counterfeit. The only authorised exceptions are reproductions strictly reserved for the use of the typist and not for the purpose of any collective use; or analyses and short quotations required due to the scientific or information nature of the work in which they figure (article L.122-5 of the Intellectual Property Code). This document has been drawn up under the initiative and direction of the CSTB, which has brought together the opinions of all interested parties.

© CSTB

MODIFICATION HISTORY

Revision No.	Date	Modifications
00	31/10/2019	Creation of the document.
01	18/03/2021	Editorial update according to the structure in force following the creation of the Technical management appendix of the NF076 reference system rev. 12.

Table des matières

1	Scope	5
2	Definitions	5
3	Materials/Design/Manufacture	5
4	Technical Requirements	5
4.1	Dimensions	5
4.2	Impact resistance of the connection elements	6
4.3	Tightness	6
4.4	Fixing the flush pipe and discharge pipe firmly onto the built-in frame	8
4.5	Compatibility of the connection elements with the products used for disinfection of water distribution networks	8
4.6	Marking	9

1 Scope

This document specifies the requirements pertaining to the design and performance, as well as the test methods applicable to the connection elements used for toilets, urinals and squat toilets.

This document does not cover the following: extensible discharge pipes, discharge pipes with tapping or pipes with a trap.

2 Definitions

Discharge pipe:

Multi-material connection element(s) designed to connect toilets, urinals, bedpan closets and squat toilets (wall-hung or pedestal) to the drainage system.

Flush pipe:

Connecting tube between the flushing cistern and the WC pan water supply system, the urinal, the bedpan toilet and the squat toilet.

3 Materials/Design/Manufacture

All the materials used shall be compatible in terms of use. No material may be excluded from the above-mentioned scope provided that the connection elements comply with the technical requirements in § 4.

Manufacturers shall declare the hardness classification applicable to the joint seals used in accordance with Standard NF EN 681-1 § 3.

The elastomers and silicones used for the joint seals shall have a sufficient life span that is compatible with their intended use, and low moisture content regain. In addition, their resistance to disinfecting products shall be satisfactory.

Elastomers shall comply with the following:

- specifications 4.2.3, 4.2.4, 4.2.5, 4.2.8, 4.2.9 for the corresponding classes in Table 2 of Standard NF EN 681-1
or
- specifications 5.3, 5.4, 5.5, 5.8, 5.9 for the corresponding classes in Table 2 of Standard NF EN 681-2.

4 Technical Requirements

4.1 Dimensions

The flush pipe shall comply with Standard NF EN 14055.

The discharge pipe shall conform to devices that comply with Standards NF EN 33, NF EN 80 or NF D 11-130. In addition, its diameter shall comply with the following standards pertaining to piping systems for wastewater discharge:

- NF EN 1329-1 for PVC-U piping
- NF EN 1451-1 for PP piping
- NF EN 1519-1 for PE piping
- NF EN 877/A1 for cast iron piping

If the discharge pipe can be cut again, the diameter shall be measured over the whole cutting range declared by the manufacturer.

4.2 Impact resistance of the connection elements

The test is performed on unassembled discharge pipes and flush pipes.

It shall be conducted at $23^{\circ}\text{C} \pm 5^{\circ}\text{C}$ and consists in dropping each connection element as delivered three times in a row, from a table from a height of 800 mm, + 50 mm, - 50 mm onto a concrete surface, by positioning the samples differently before the next drop.

At the end of the three drops, the tested sample shall not show any sign of deformation visible to the naked eye, or any crack likely to impair its proper functioning.

4.3 Tightness

4.3.1 Water tightness of the discharge pipe

The test shall be carried out after the impact resistance test specified in § 4.2, using the test bench described in Figure 1.

The discharge pipe (oriented upwards) shall be connected to the metal template described in Figure 2 in accordance with the manufacturer's installation instructions (lubrication of the joint seal). The pipe to be tested shall be held vertically throughout the duration of the test. The tightness test shall be undertaken by filling up the pipe completely with water.

Specification: no leakage for at least 15 min.

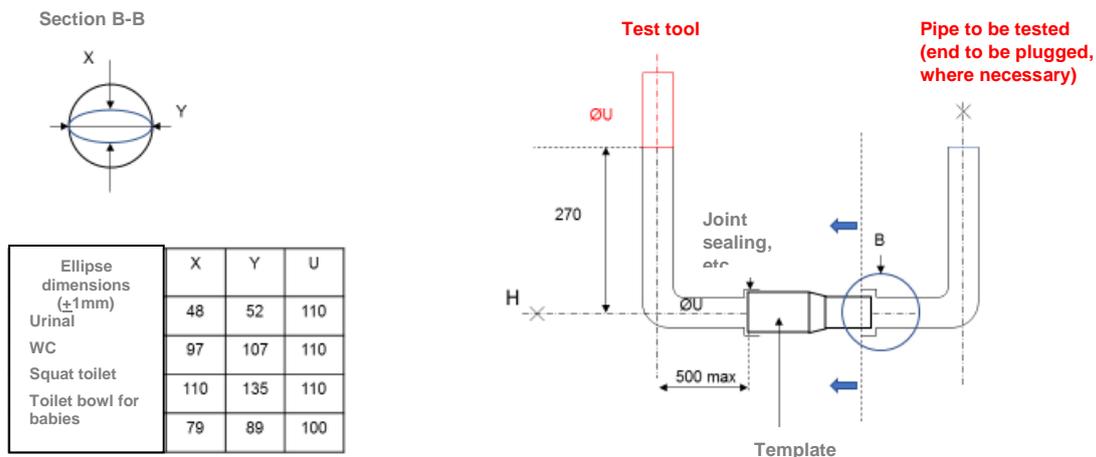


Figure 1: Test arrangement for water tightness (dimensions in mm)

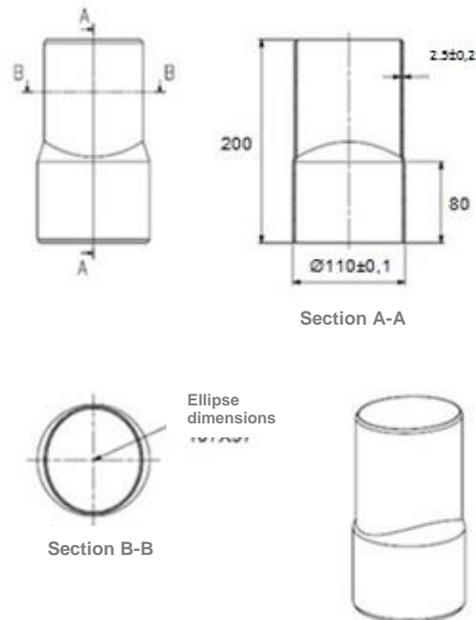


Figure 2: Template for water tightness test to simulate the sanitary appliances' outlet (dimensions in mm)

4.3.2 Air tightness of the discharge pipe

The test shall be carried out on all the elements that make up the discharge pipe using the test arrangement described in Figure 3, making sure that the water temperature does not vary by more than $\pm 2^{\circ}\text{C}$ during the test.

The discharge pipe shall be installed on the test bench according to the manufacturer's installation instructions (lubrication of the joint seal).

It shall be connected to an air tight pipe, $2.0\text{l} \pm 0.2\text{l}$ in volume, which shall be as short as possible.


A positive pressure of 200^{+50}_0 Pa shall be applied by means of a hand-operated pump (or equivalent).

The pressure measurements shall be carried out using an incline tube manometer, a U-tube manometer or similar.

Once the pressure is stable, valve 2 (see Figure 3) is to be closed.

If the pressure has not stabilized within 2 min, the test shall be interrupted (test failed).

After 15 min, make sure that the pressure has not dropped by $\geq 10\%$ of the stabilized value.

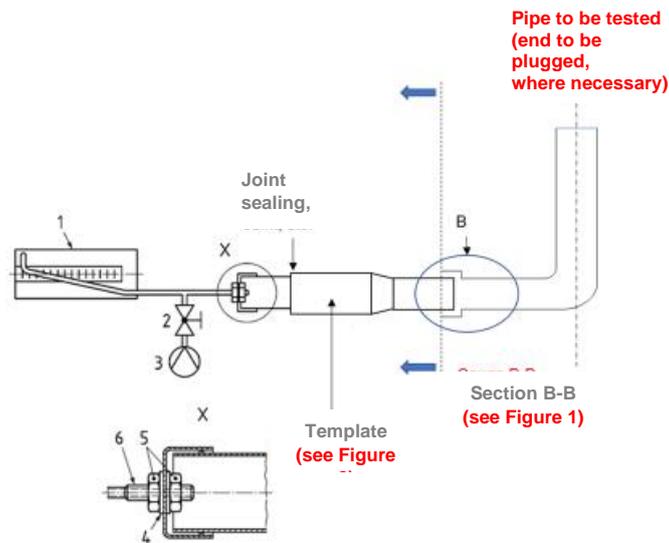

Caption

- 1 incline tube manometer or U-tube manometer or similar
- 2 valve
- 3 pump
- 4 seal and washers
- 5 nuts
- 6 threaded end of tube

Figure 3: Test arrangement for air tightness

4.4 Fixing the flush pipe and discharge pipe firmly onto the built-in frame

In order to check that the connection elements are properly fixed onto the built-in frame, a WC pan is to be installed on the frame according to the manufacturer’s instructions.

The flush pipe and the discharge pipe shall remain integral with the built-in frame.

4.5 Compatibility of the connection elements with the products used for disinfection of water distribution networks

All the materials used for flush pipes and discharge pipes shall be compatible with the products used for the disinfection of networks. All the constituent parts, and in particular those made of elastomer, shall be compatible with water treated with potassium permanganate or sodium hypochlorite when disinfecting the networks.

This compatibility shall be verified by placing the inner parts of the flush pipe and discharge pipe into contact with the following products:

- for 96h, with a solution containing 0.30 g potassium permanganate per litre of demineralized water,
- for 24h, with a solution containing 0.10 g sodium hypochlorite per litre of demineralized water.

The test shall be conducted at ambient temperature.

At the end of the test, a visual examination of the connection elements shall be made and shall not reveal any change in appearance, or any deformation.

4.6 Marking

The connection elements shall be marked clearly and durably and specify the following: casting, engraving, painting, punching, labelling, etc.:

- Manufacturer's name and/or trademark and/or code
- Identification of the diameter (DE)

In addition, manufacturers shall implement a quality system to ensure traceability of the products.

Trame_document_technique_VA_R3_PC_rev00